



Vault™ Self Cleaning HYPO Specifications

The MIOX Vault on-site generator is designed for high efficiency, low lifecycle cost, durability and reliability. The self-cleaning Vault with self-adjusting flow control is virtually maintenance free. With over 40% improved salt and energy efficiencies and a new self-cleaning system, the Vault is built for cost-effective, problem-free operation. The Vault features an easy-to-upgrade cell to convert between sodium hypochlorite (HYPO) and advanced Mixed Oxidant Solution (MOS) with expandable capacity for ultimate flexibility. Using just salt and power to generate a dilute chlorine-based solution eliminates the storage and handling of hazardous disinfection chemicals while providing chlorine residual.


	H Vault 25	H Vault 50	H Vault 75	H Vault 100
Rated FAC Capacity	25 lbs/day 11.3 kg/day	50 lbs/day 22.7 kg/day	75 lbs/day 34 kg/day	100 lbs/day 45.4 kg/day
Water Treatment Capacity (at 1 ppm FAC)	3.0 MGD 11,355 m ³ /day	6.0 MGD 22,710 m ³ /day	9.0 MGD 34,065 m ³ /day	12.0 MGD 45,420 m ³ /day
Salt Conversion (SCE)*	3.0 lb salt/lb FAC 3.0 kg salt/kg FAC			
Energy Conversion (ECE)*	2.0 kW-hr/lb FAC 4.4 kW-hr/kg FAC			
FAC Concentration*	6,500 mg/L (+/- 1,000)			
Flow Rate	22.5 gph (+/- 15%) 85.2 lph (+/- 15%)	45 gph (+/- 15%) 170.4 lph (+/- 15%)	67.5 gph (+/- 15%) 255.6 lph (+/- 15%)	90 gph (+/- 15%) 340.8 lph (+/- 15%)
Nominal Energy to Unit	13 A 3 KVA	26 A 6 KVA	39 A 9 KVA	52 A 12 KVA
Electrical Service Requirement (OSG Only)	200-240 VAC, 1 ph, 30A, 50/60 hertz	200-240 VAC, 1 ph, 60A, 50/60 hertz	200-240 VAC, 1 ph, 90A, 50/60 hertz	200-240 VAC, 1 ph, 120A, 50/60 hertz
Air Temp. Required	45° to 110° F 7.2° to 43.3° C			
Recommended Feed Water Temperature*	50° to 80° F 10° to 26.7° C			
Allowable Feed Water Temperature*	40° to 95° F 5° to 35° C			
Feed Water Pressure	25 to 100 psi 172 to 689 kPa			
Energy Add for Internal Vent	0.7 kW	1.4 kW	2.1 kW	2.8 kW
Approximate Dimensions (WxDxH)	36 x 17.4 x 65.5 inches 91.44 x 44.2 x 166.37 cm			
Self Cleaning	YES			

*Performance may vary depending on salt quality, water quality, and water temperature.

Note: This electronic document is controlled. Once this document is printed it becomes uncontrolled and obsolete. Refer only to electronic document for the latest information.



Vault Drawing

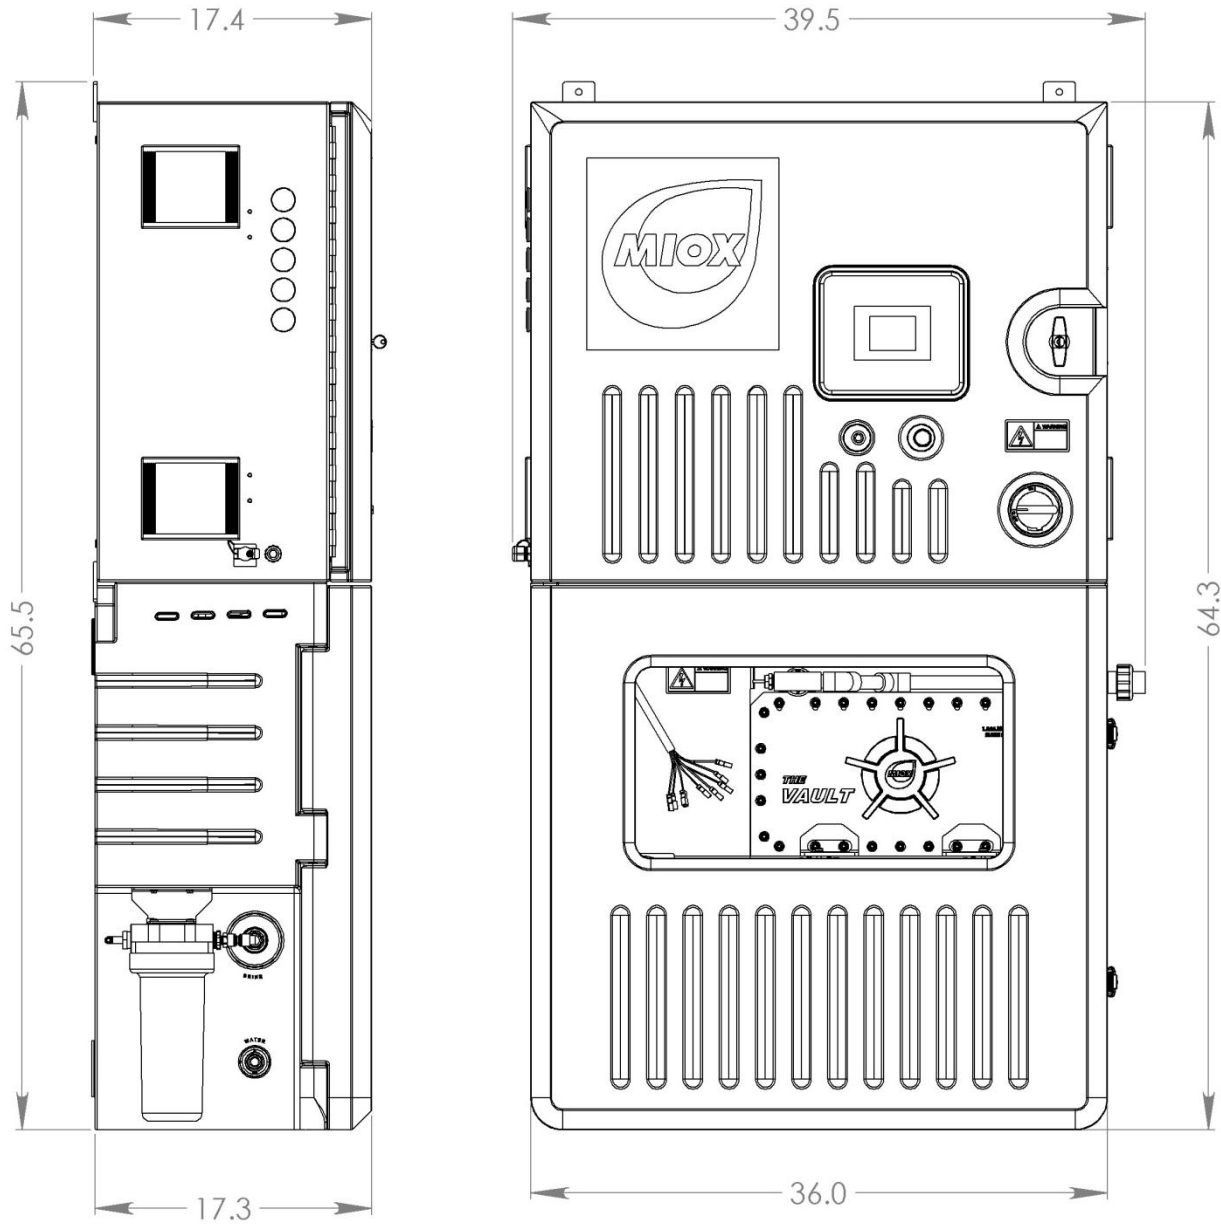

REFERENCE GENERAL ARRANGEMENT DRAWING 112-00001
FOR INSTALLATION REQUIREMENTS

Note: This electronic document is controlled. Once this document is printed it becomes uncontrolled and obsolete. Refer only to electronic document for the latest information.

